

## Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%



400kv system  
V-INFINI : 1.05 (st.dev 0.05 p.u.)

P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 951.58 MW

Vl : 360.32 kv

Xinf : 59.956 ohm

CCT(SBS) : 121.6 ms

Qu : -226.1 Mvar


Pl : -84.09 MW

Vinf : 363.32 kv


Ceci est un cas instable

Path in the DT

DT2 : TOP-NODE, T19, T26, T28, D26, (Conclusion is, SECURE, ),


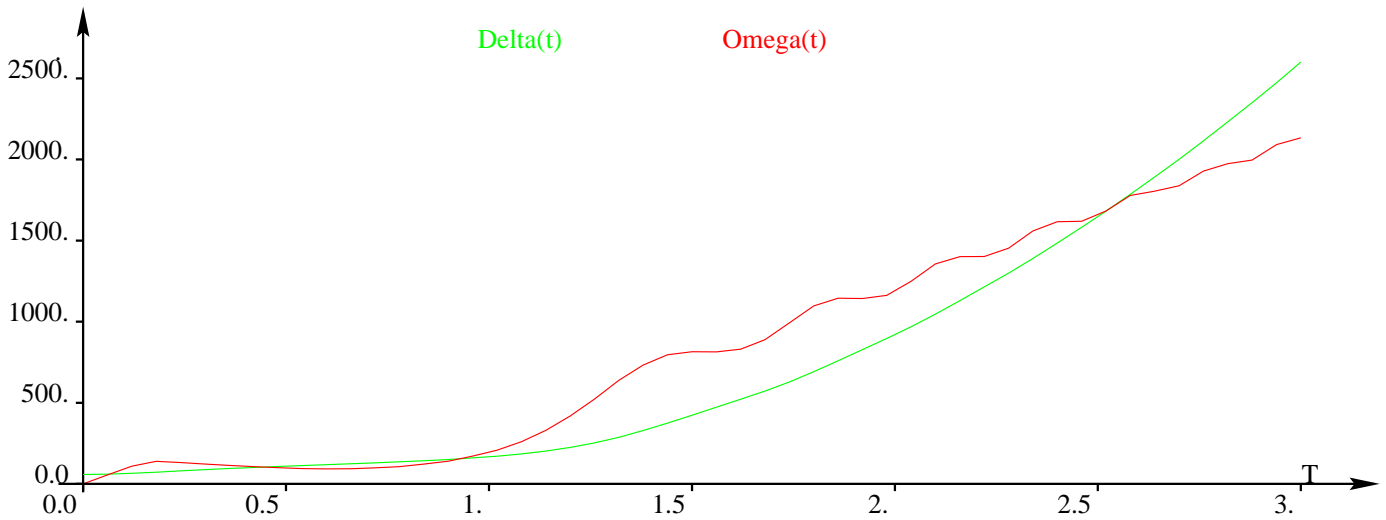


MLP hidden layer activations (between -1 and 1)

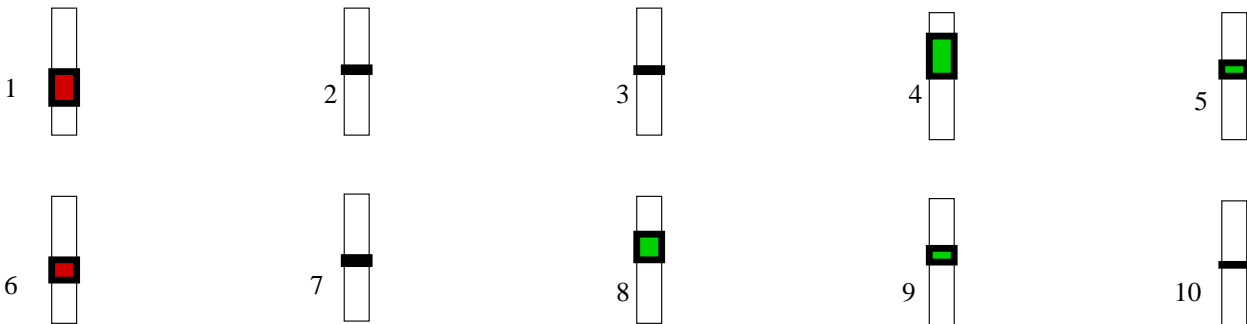

MLP output activation 0.19537857

Model output 0.0

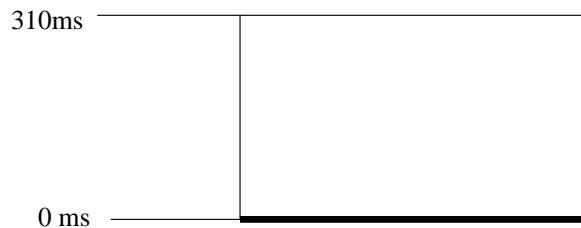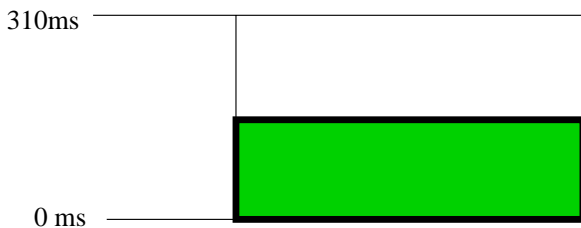

OP9049