

# Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%



400kv system  
V-INFINI : 1.05 (st.dev 0.05 p.u.)

P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 787.01 MW

Vl : 366.51 kv

Xinf : 70.861 ohm

CCT(SBS) : 126.5 ms

Qu : -623.9 Mvar


Pl : -104.7 MW

Vinf : 367.73 kv


**Ceci est un cas instable**

Path in the DT

DT2 : TOP-NODE, T19, T20, T24, T25, D18, (Conclusion is, SECURE, )

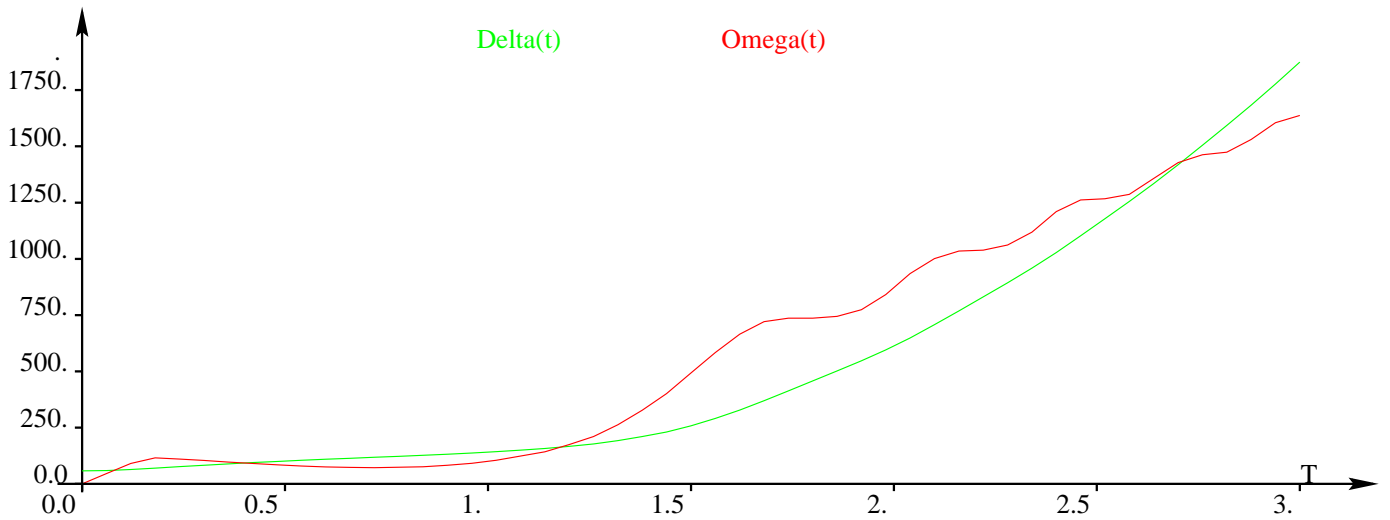


MLP hidden layer activations (between -1 and 1)

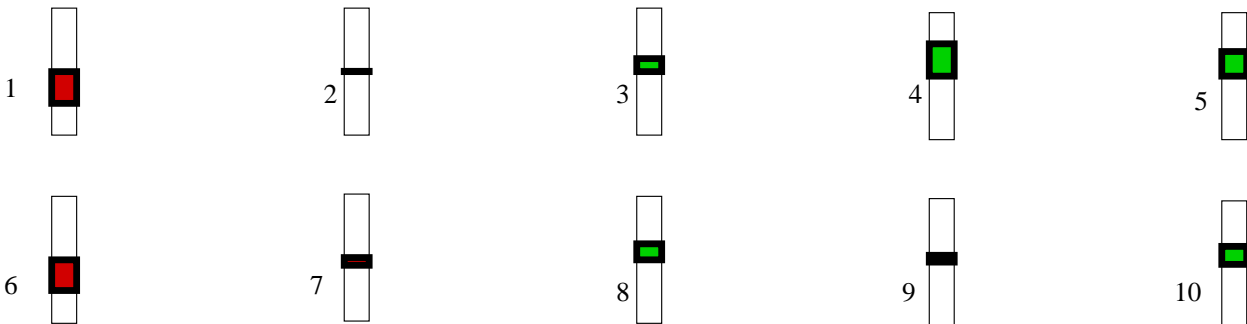

MLP output activation 0.2315467

Model output 0.0

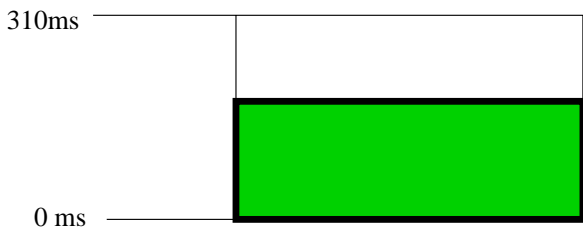

OP9368