


Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%

400kv system
V-INFINI : 1.05 (st.dev 0.05 p.u.)



P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 1001.8 MW

Vl : 403.25 kv

Xinf : 66.456 ohm

CCT(SBS) : 141.1 ms

Qu : -470.5 Mvar


Pl : -104.6 MW

Vinf : 406.15 kv


Ceci est un cas instable

Path in the DT

DT2 : TOP-NODE, T19, T20, T21, T22, D16, (Conclusion is, SECURE,)


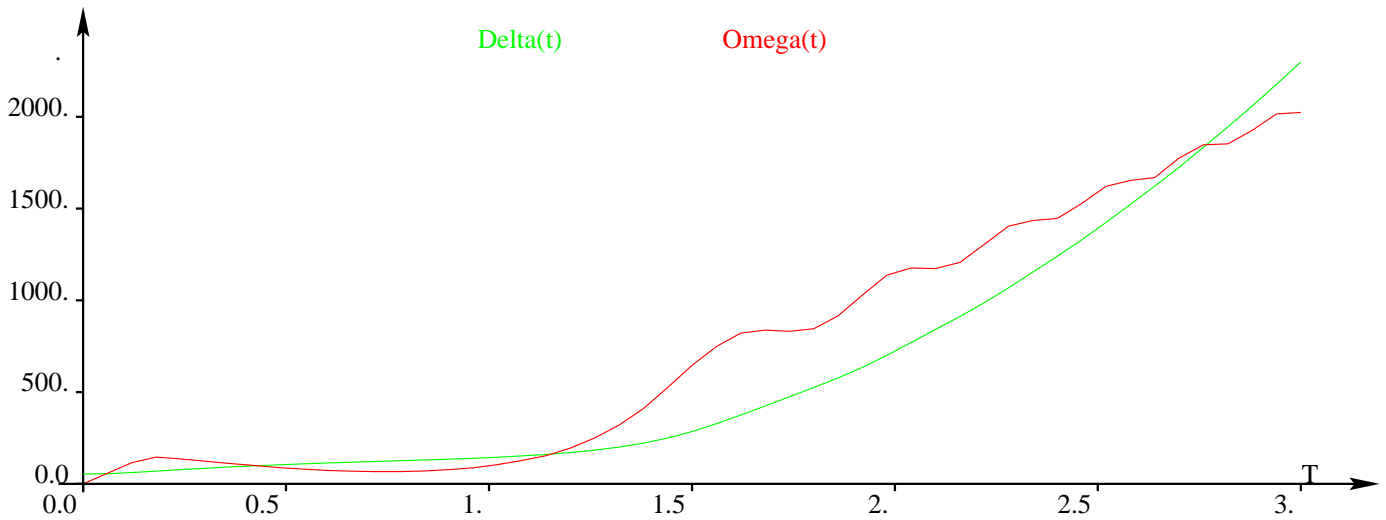


MLP hidden layer activations (between -1 and 1)

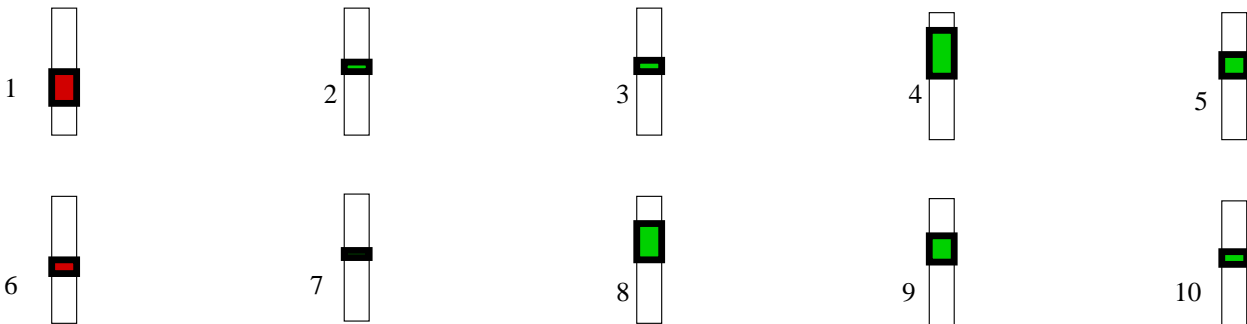

MLP output activation 0.14640477

Model output 0.0

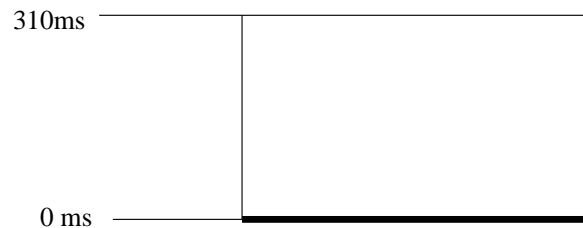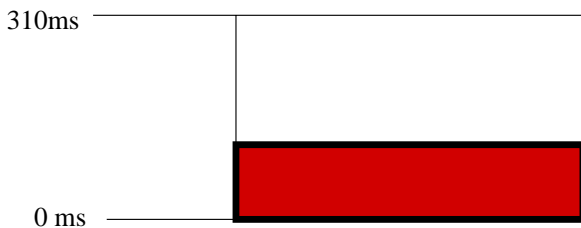

OP9499