

Data base OMIB (ULg, L. Wehenkel)

1650MVA


H=5.6s

Xt=87%

400kv system
V-INFINI : 1.05 (st.dev 0.05 p.u.)

P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

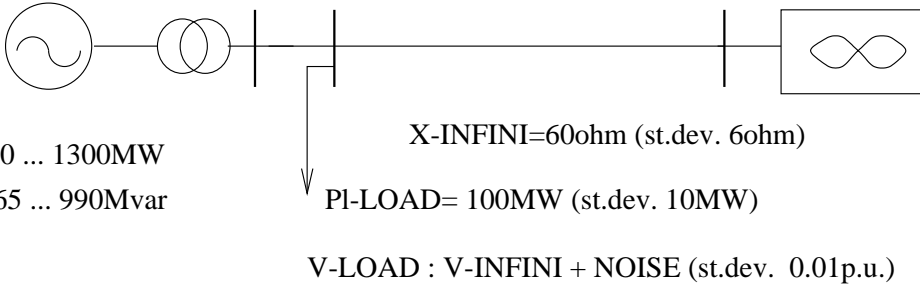

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 1074.7 MW

Vl : 424.23 kv

Xinf : 66.302 ohm

CCT(SBS) : 132.3 ms

Qu : -636.7 Mvar


Pl : -95.5 MW

Vinf : 425.64 kv


Ceci est un cas instable

Path in the DT

DT2 : TOP-NODE, T19, T20, T21, T22, T23, D15, (Conclusion is, SECURE,),

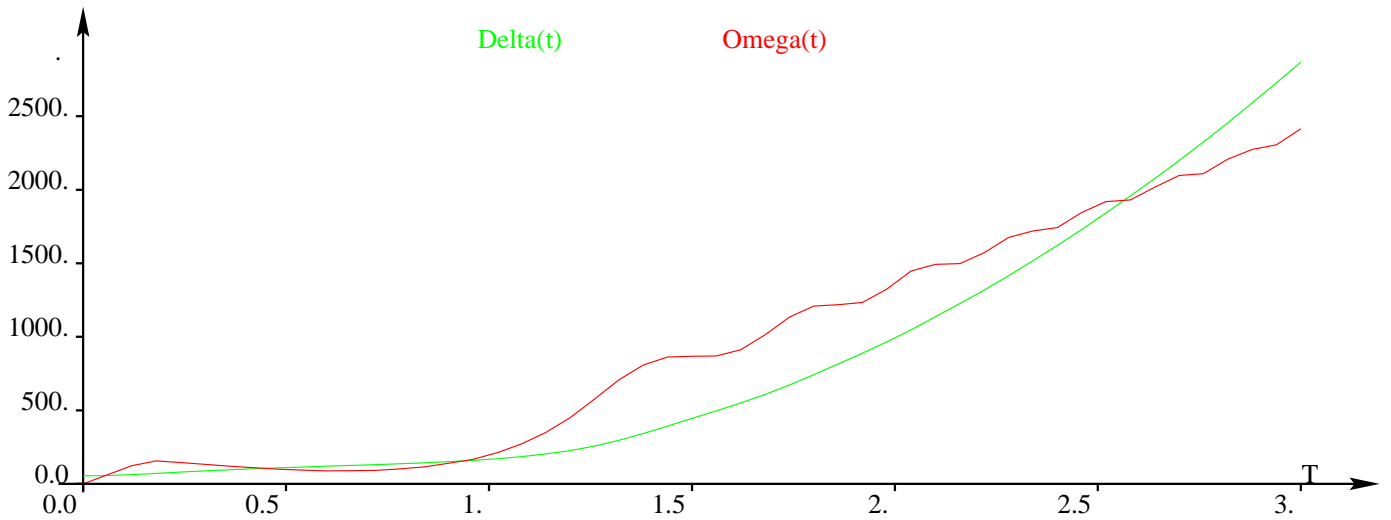


MLP hidden layer activations (between -1 and 1)

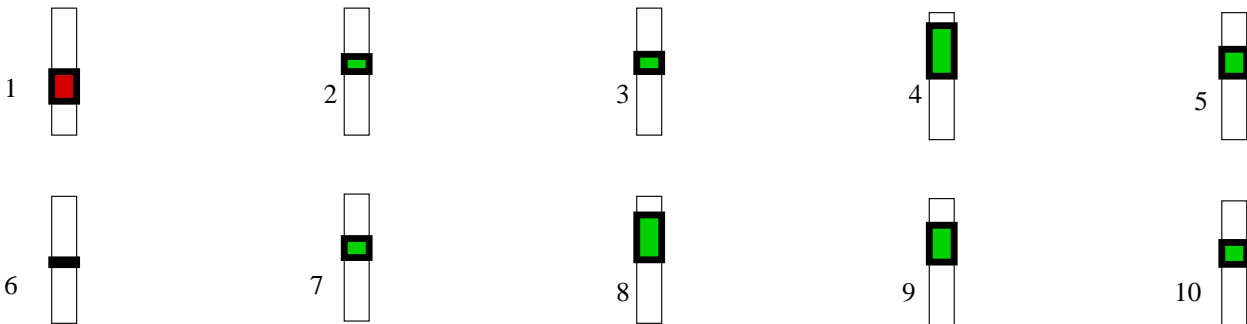

MLP output activation 0.09935029

Model output 0.0

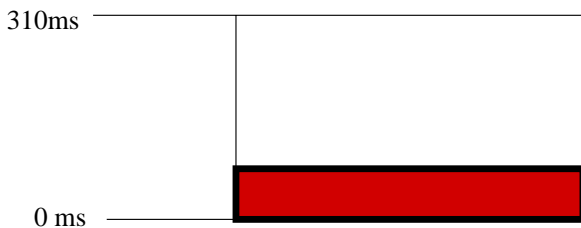

OP9590