


Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%

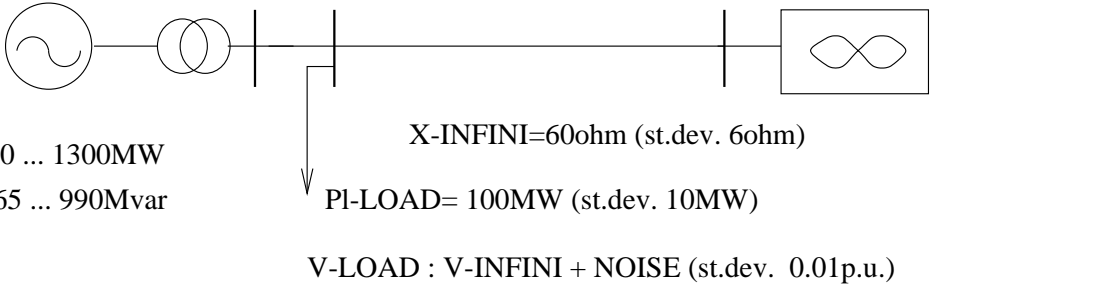

P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

Pu : 1091.8 MW

Vl : 412.58 kv

Xinf : 54.195 ohm

CCT(SBS) : 154.8 ms

Qu : -443.9 Mvar


Pl : -113.4 MW

Vinf : 415.12 kv


Ceci est un cas instable

Path in the DT

DT2 : TOP-NODE, T2, T3, T4, T6, D3, (Conclusion is, SECURE,),


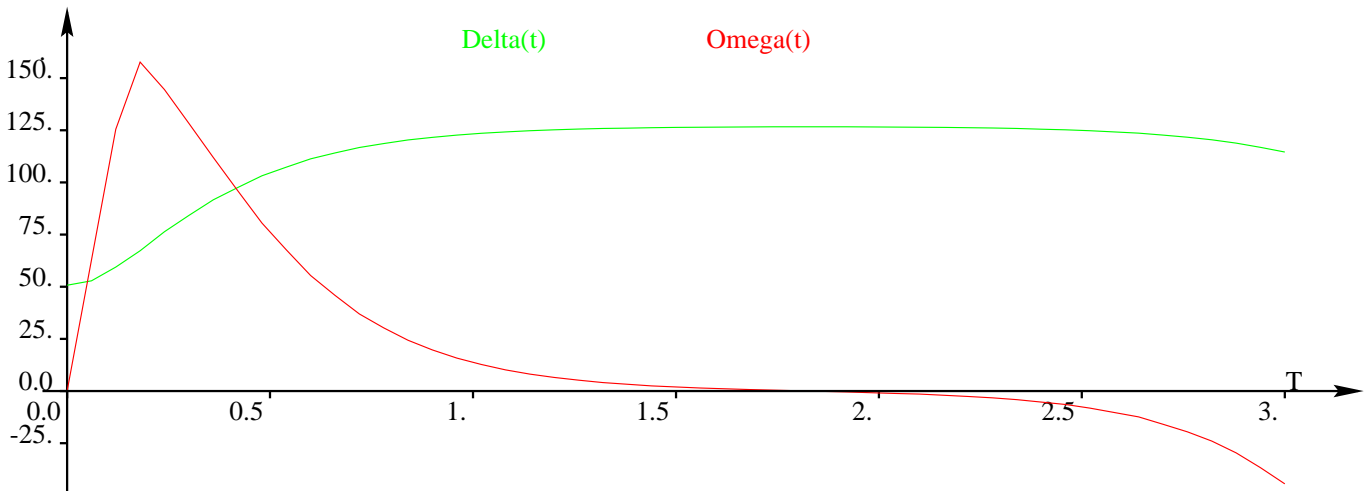


MLP hidden layer activations (between -1 and 1)

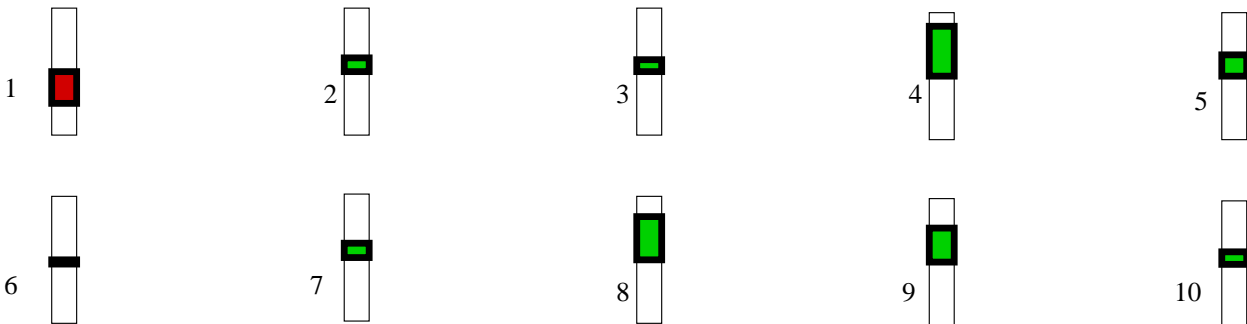

MLP output activation 0.11618377

Model output 0.0

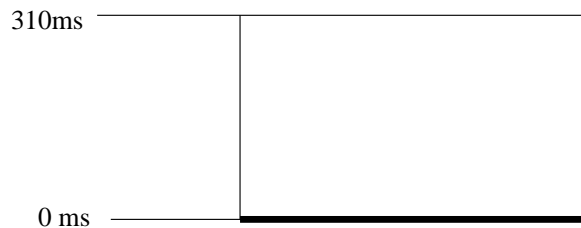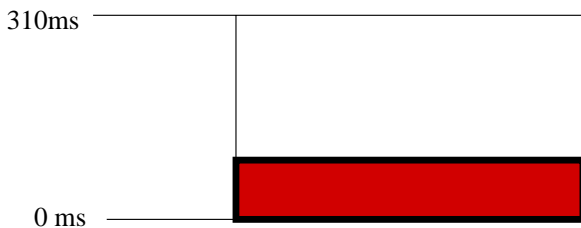

OP9993