


## Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%

400kv system  
V-INFINI : 1.05 (st.dev 0.05 p.u.)



P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 1100.9 MW

Vl : 358.57 kv

Xinf : 56.282 ohm

CCT(SBS) : 161.6 ms

Qu : 866.22 Mvar


Pl : -104.0 MW

Vinf : 359.59 kv


Ceci est un cas stable

Path in the DT

DT2 : TOP-NODE, T2, T8, T9, T12, D9, (Conclusion is, INSECURE, ),

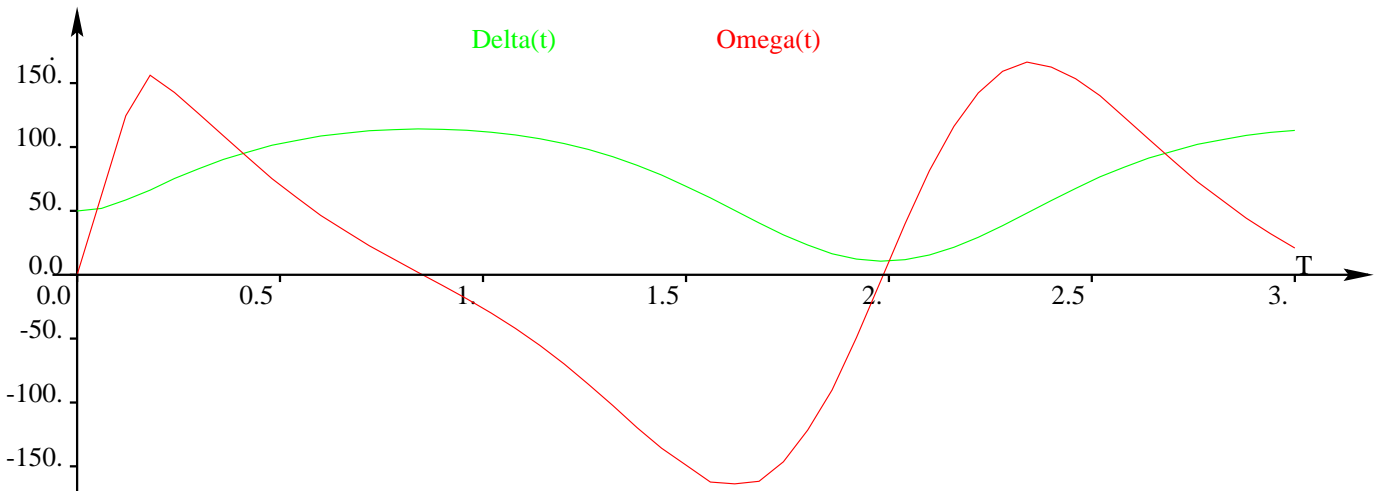


MLP hidden layer activations (between -1 and 1)

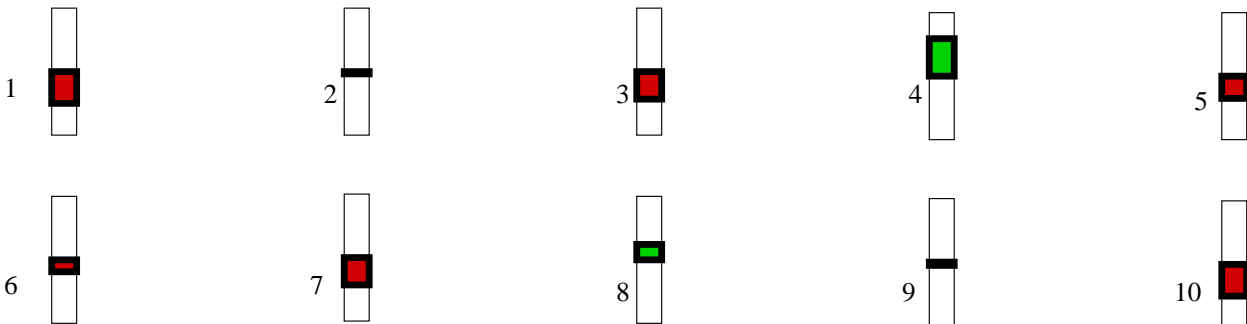

MLP output activation 0.20754315

Model output 0.0

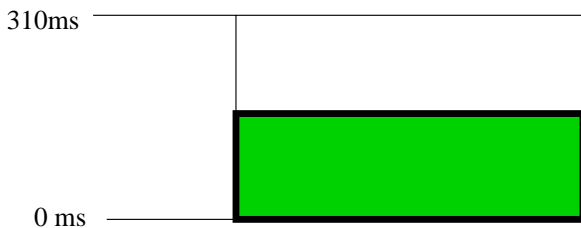

OP9761