

Data base OMIB (ULg, L. Wehenkel)

1650MVA

H=5.6s

Xt=87%

400kv system
V-INFINI : 1.05 (st.dev 0.05 p.u.)



P-UNIT : 700 ... 1300MW

Q-UNIT: -665 ... 990Mvar

X-INFINI=60ohm (st.dev. 6ohm)

PI-LOAD= 100MW (st.dev. 10MW)

V-LOAD : V-INFINI + NOISE (st.dev. 0.01p.u.)

Pu : 1066.9 MW

Vl : 385.17 kv

Xinf : 57.577 ohm

CCT(SBS) : 154.8 ms

Qu : 20.642 Mvar


Pl : -104.3 MW

Vinf : 388.56 kv


Ceci est un cas instable

Path in the DT

DT2 : TOP-NODE, T19, T26, T28, T29, T30, D25, (Conclusion is, SECURE,),


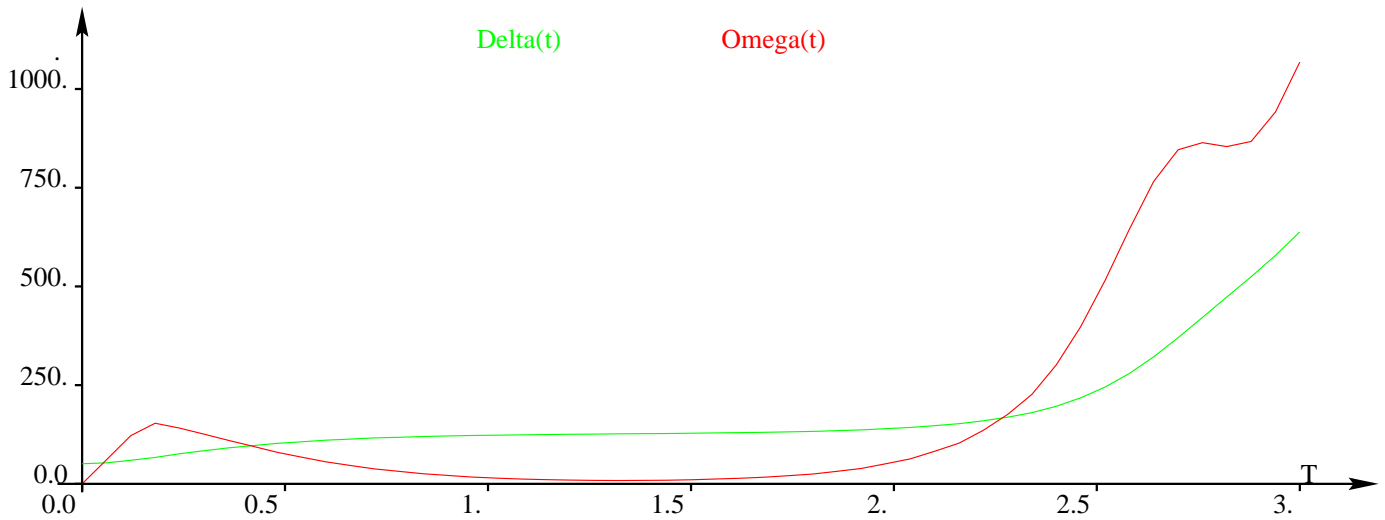


MLP hidden layer activations (between -1 and 1)

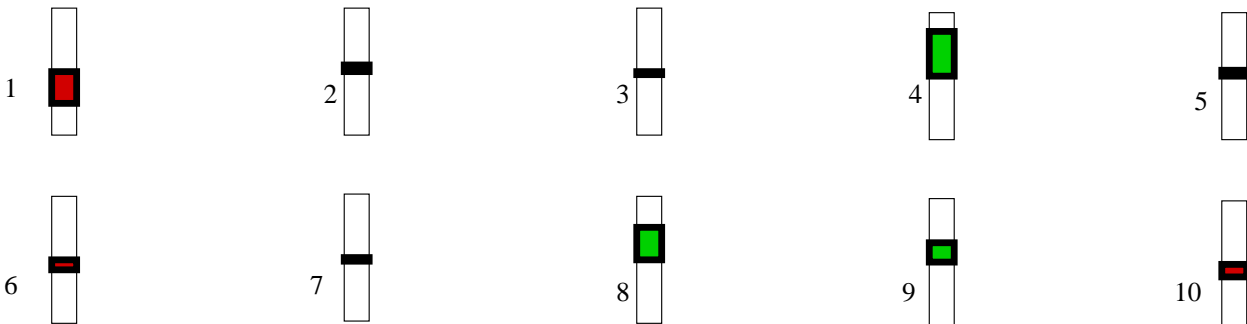

MLP output activation 0.16954184

Model output 0.0

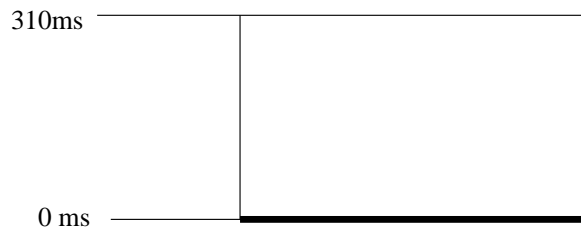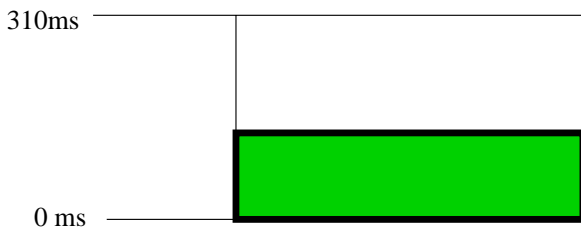

OP9828